


Air is supplied to the ducted modules from the air distribution duct through flexible branch ducts, which are secured at the bottom ends by clamps. A damper (not shown) on the inside of the collar allows balancing of the air flowing from the module to the cleanroom.



Ducted modules are mounted in 2' x 4' grids and sealed with gaskets or a liquid gel sealant. Tear drop or recessed lighting (shown) provides illumination.

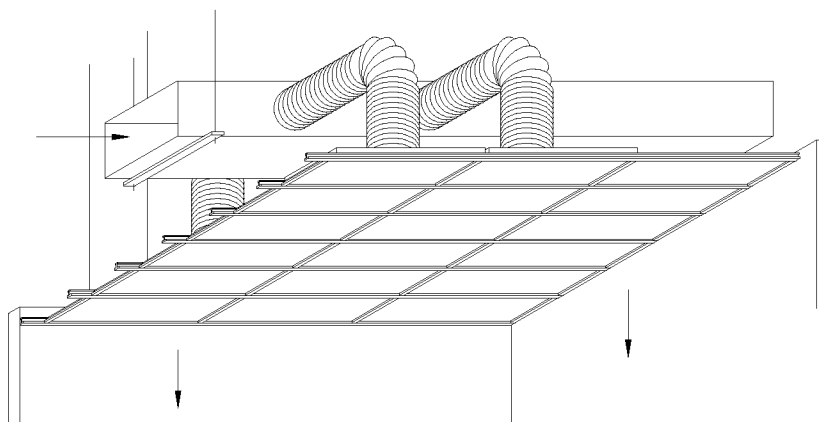

TITLE

CLEANROOM
DUCTED MODULE

FIGURE

VS-10-01

DATE

12-90