


Raised floor with depressed slab. Air is returned through a utility compartment to the air supply system.



Low sidewall grille return through a utility compartment to the air supply system. Room width is limited to 14 feet if laminar air flow is to be achieved. The distance from the top of the grille to the floor should not exceed 18 inches.

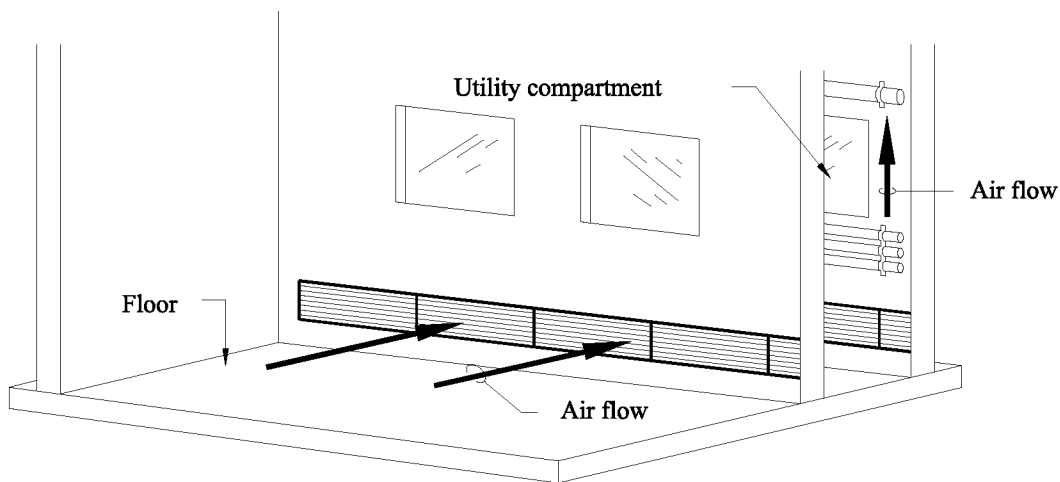

TITLE

CLEANROOM RETURN
AIR
ARRANGEMENTS

FIGURE

VS-10-03

DATE

12-90